








**nLIGHT AIR:**  
CORRIDOR / STAIRWELL - POWERPACKS W/ BATTERY SENSORS

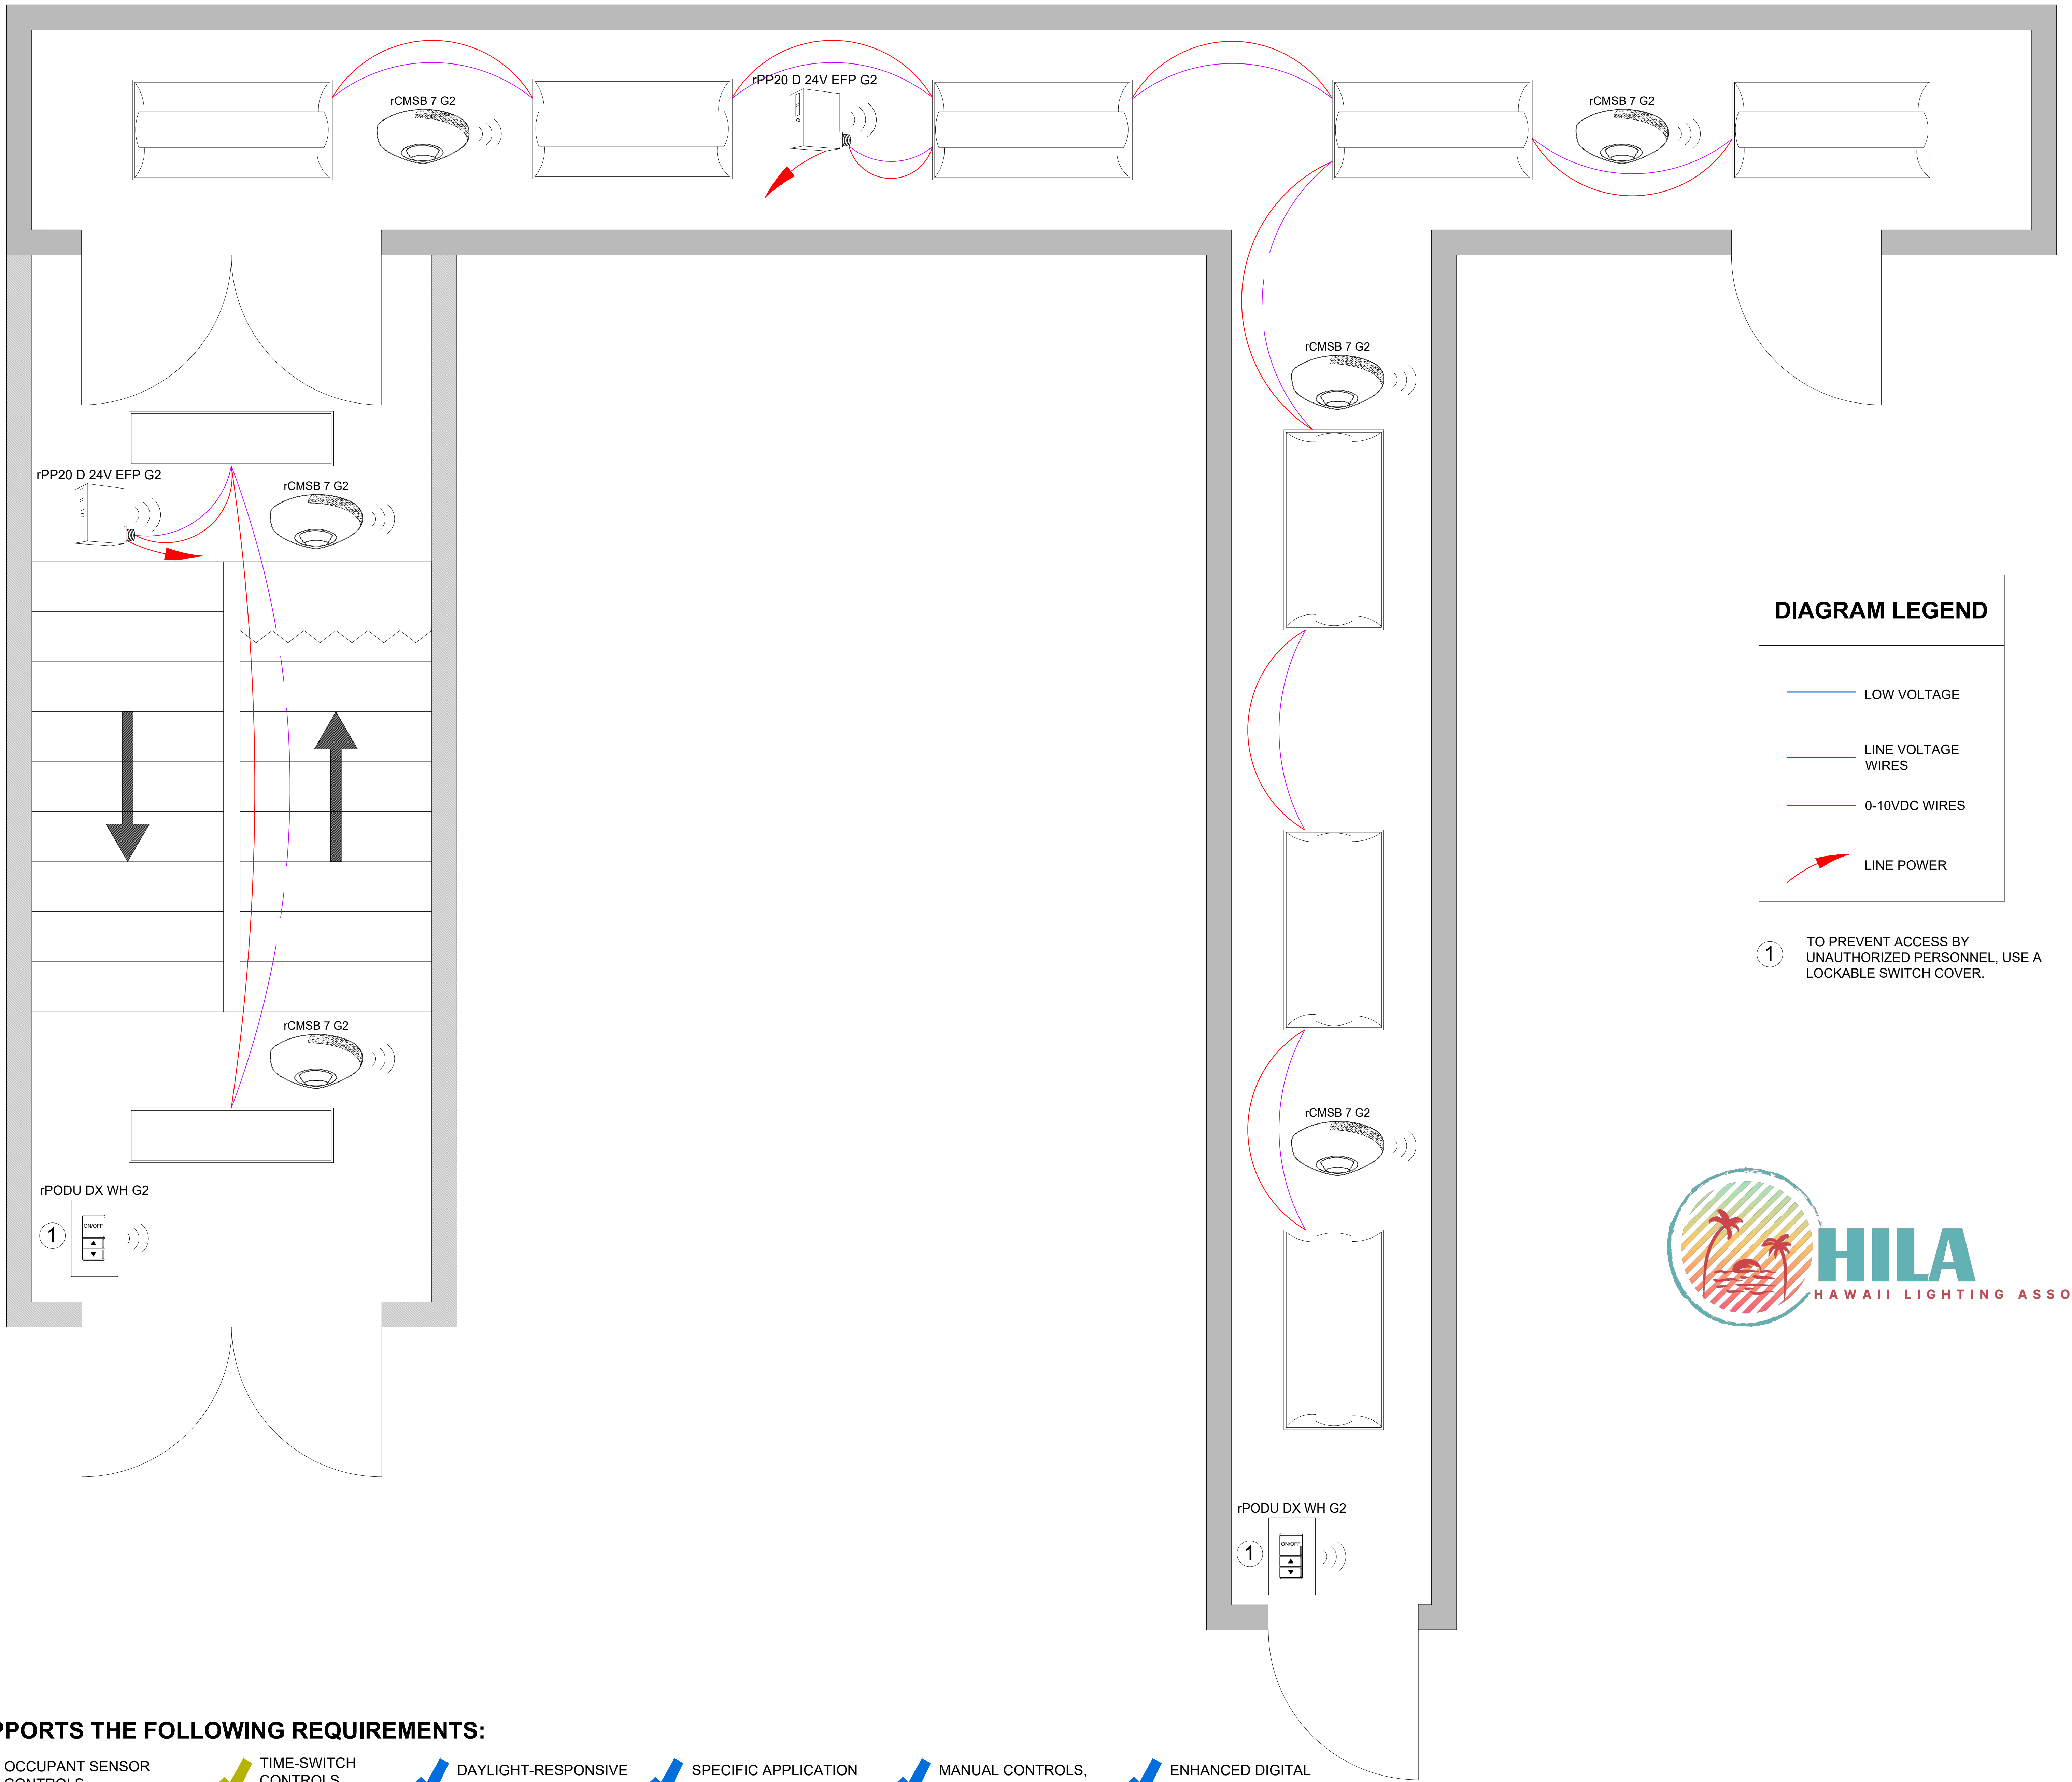


**SUPPORTS THE FOLLOWING REQUIREMENTS:**

-  OCCUPANT SENSOR CONTROLS, (C405.2.1)
-  TIME-SWITCH CONTROLS, (C405.2.2)
-  DAYLIGHT-RESPONSIVE CONTROLS, (C405.2.3)
-  SPECIFIC APPLICATION CONTROLS, (C405.2.4)
-  MANUAL CONTROLS, (C405.2.5)
-  ENHANCED DIGITAL LIGHTING CONTROLS, (C406.4)

SEE HILA BASIS OF DESIGN TO COMPLY WITH IECC 2018 SECTION C405

**nLIGHT AIR:**  
CORRIDOR / STAIRWELL - POWERPACKS W/ 24VDC SENSORS

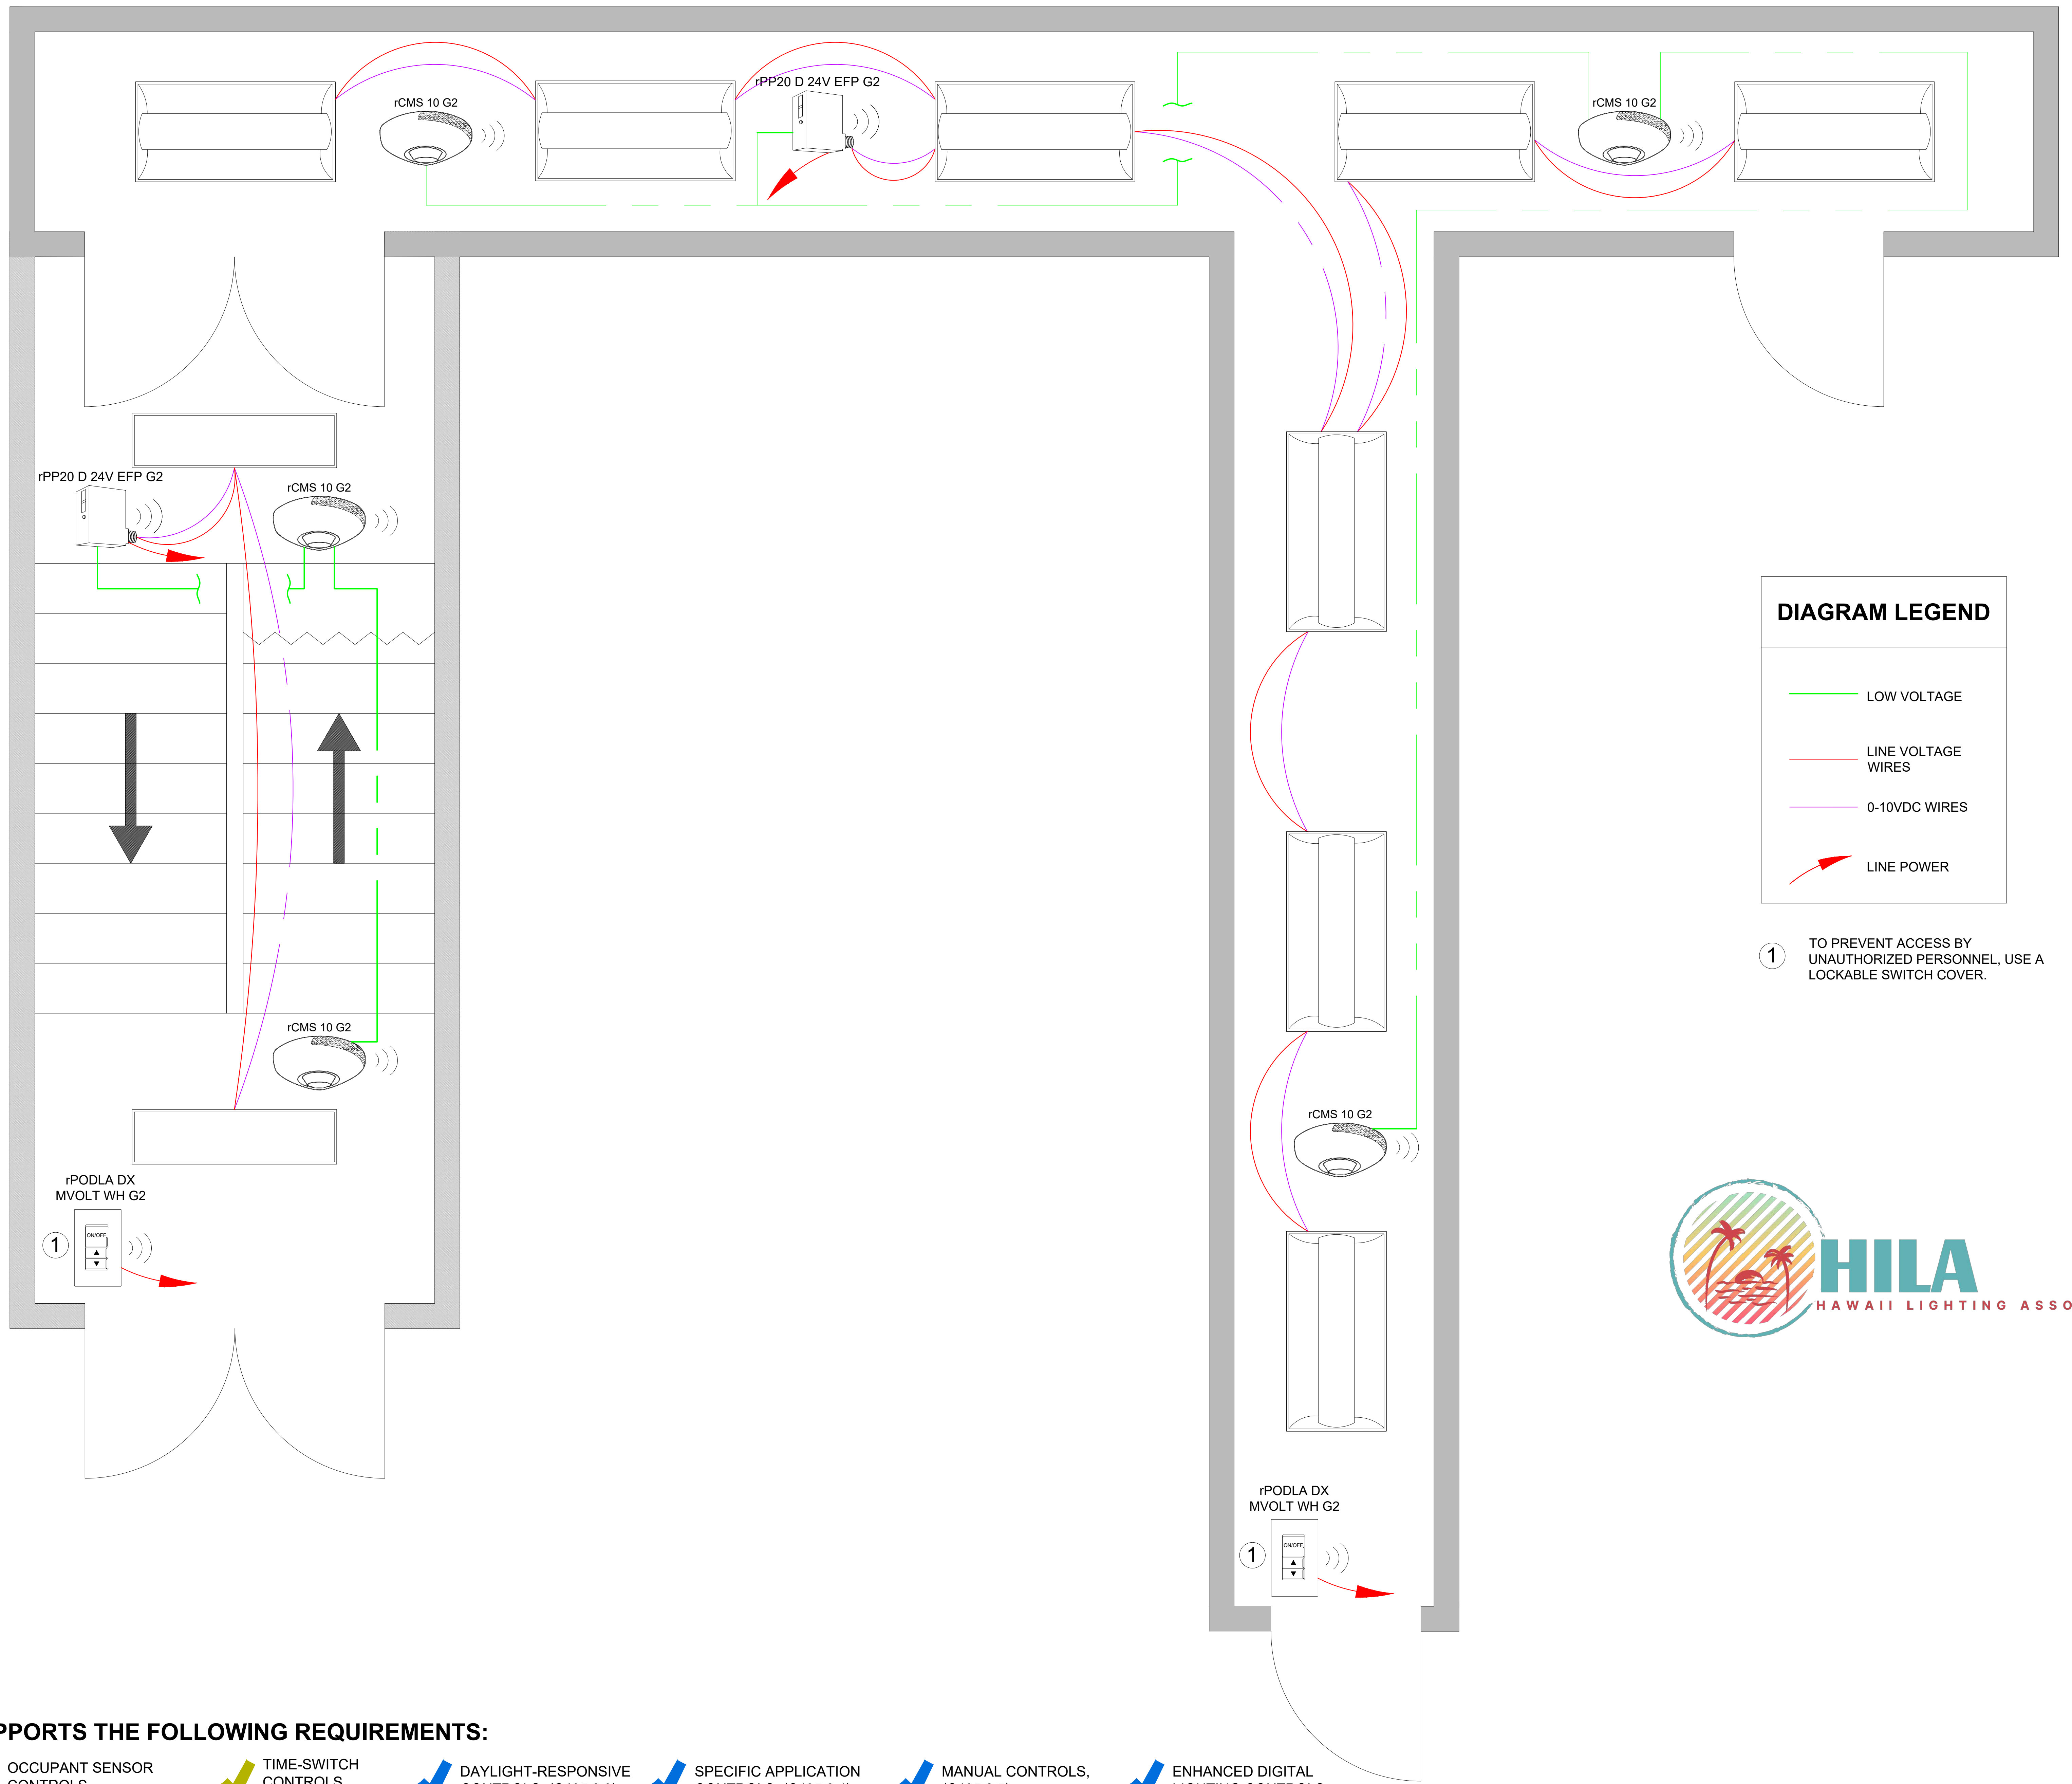

**DIAGRAM LEGEND**

- LOW VOLTAGE
- LINE VOLTAGE WIRES
- 0-10VDC WIRES
- ➔ LINE POWER

① TO PREVENT ACCESS BY UNAUTHORIZED PERSONNEL, USE A LOCKABLE SWITCH COVER.



**SUPPORTS THE FOLLOWING REQUIREMENTS:**

- ✓ OCCUPANT SENSOR CONTROLS, (C405.2.1)
- ✓ TIME-SWITCH CONTROLS, (C405.2.2)
- ✓ DAYLIGHT-RESPONSIVE CONTROLS, (C405.2.3)
- ✓ SPECIFIC APPLICATION CONTROLS, (C405.2.4)
- ✓ MANUAL CONTROLS, (C405.2.5)
- ✓ ENHANCED DIGITAL LIGHTING CONTROLS, (C406.4)

SEE HILA BASIS OF DESIGN TO COMPLY WITH IECC 2018 SECTION C405