

nLIGHT AIR:
LAB - AIR ENABLED FIXTURES

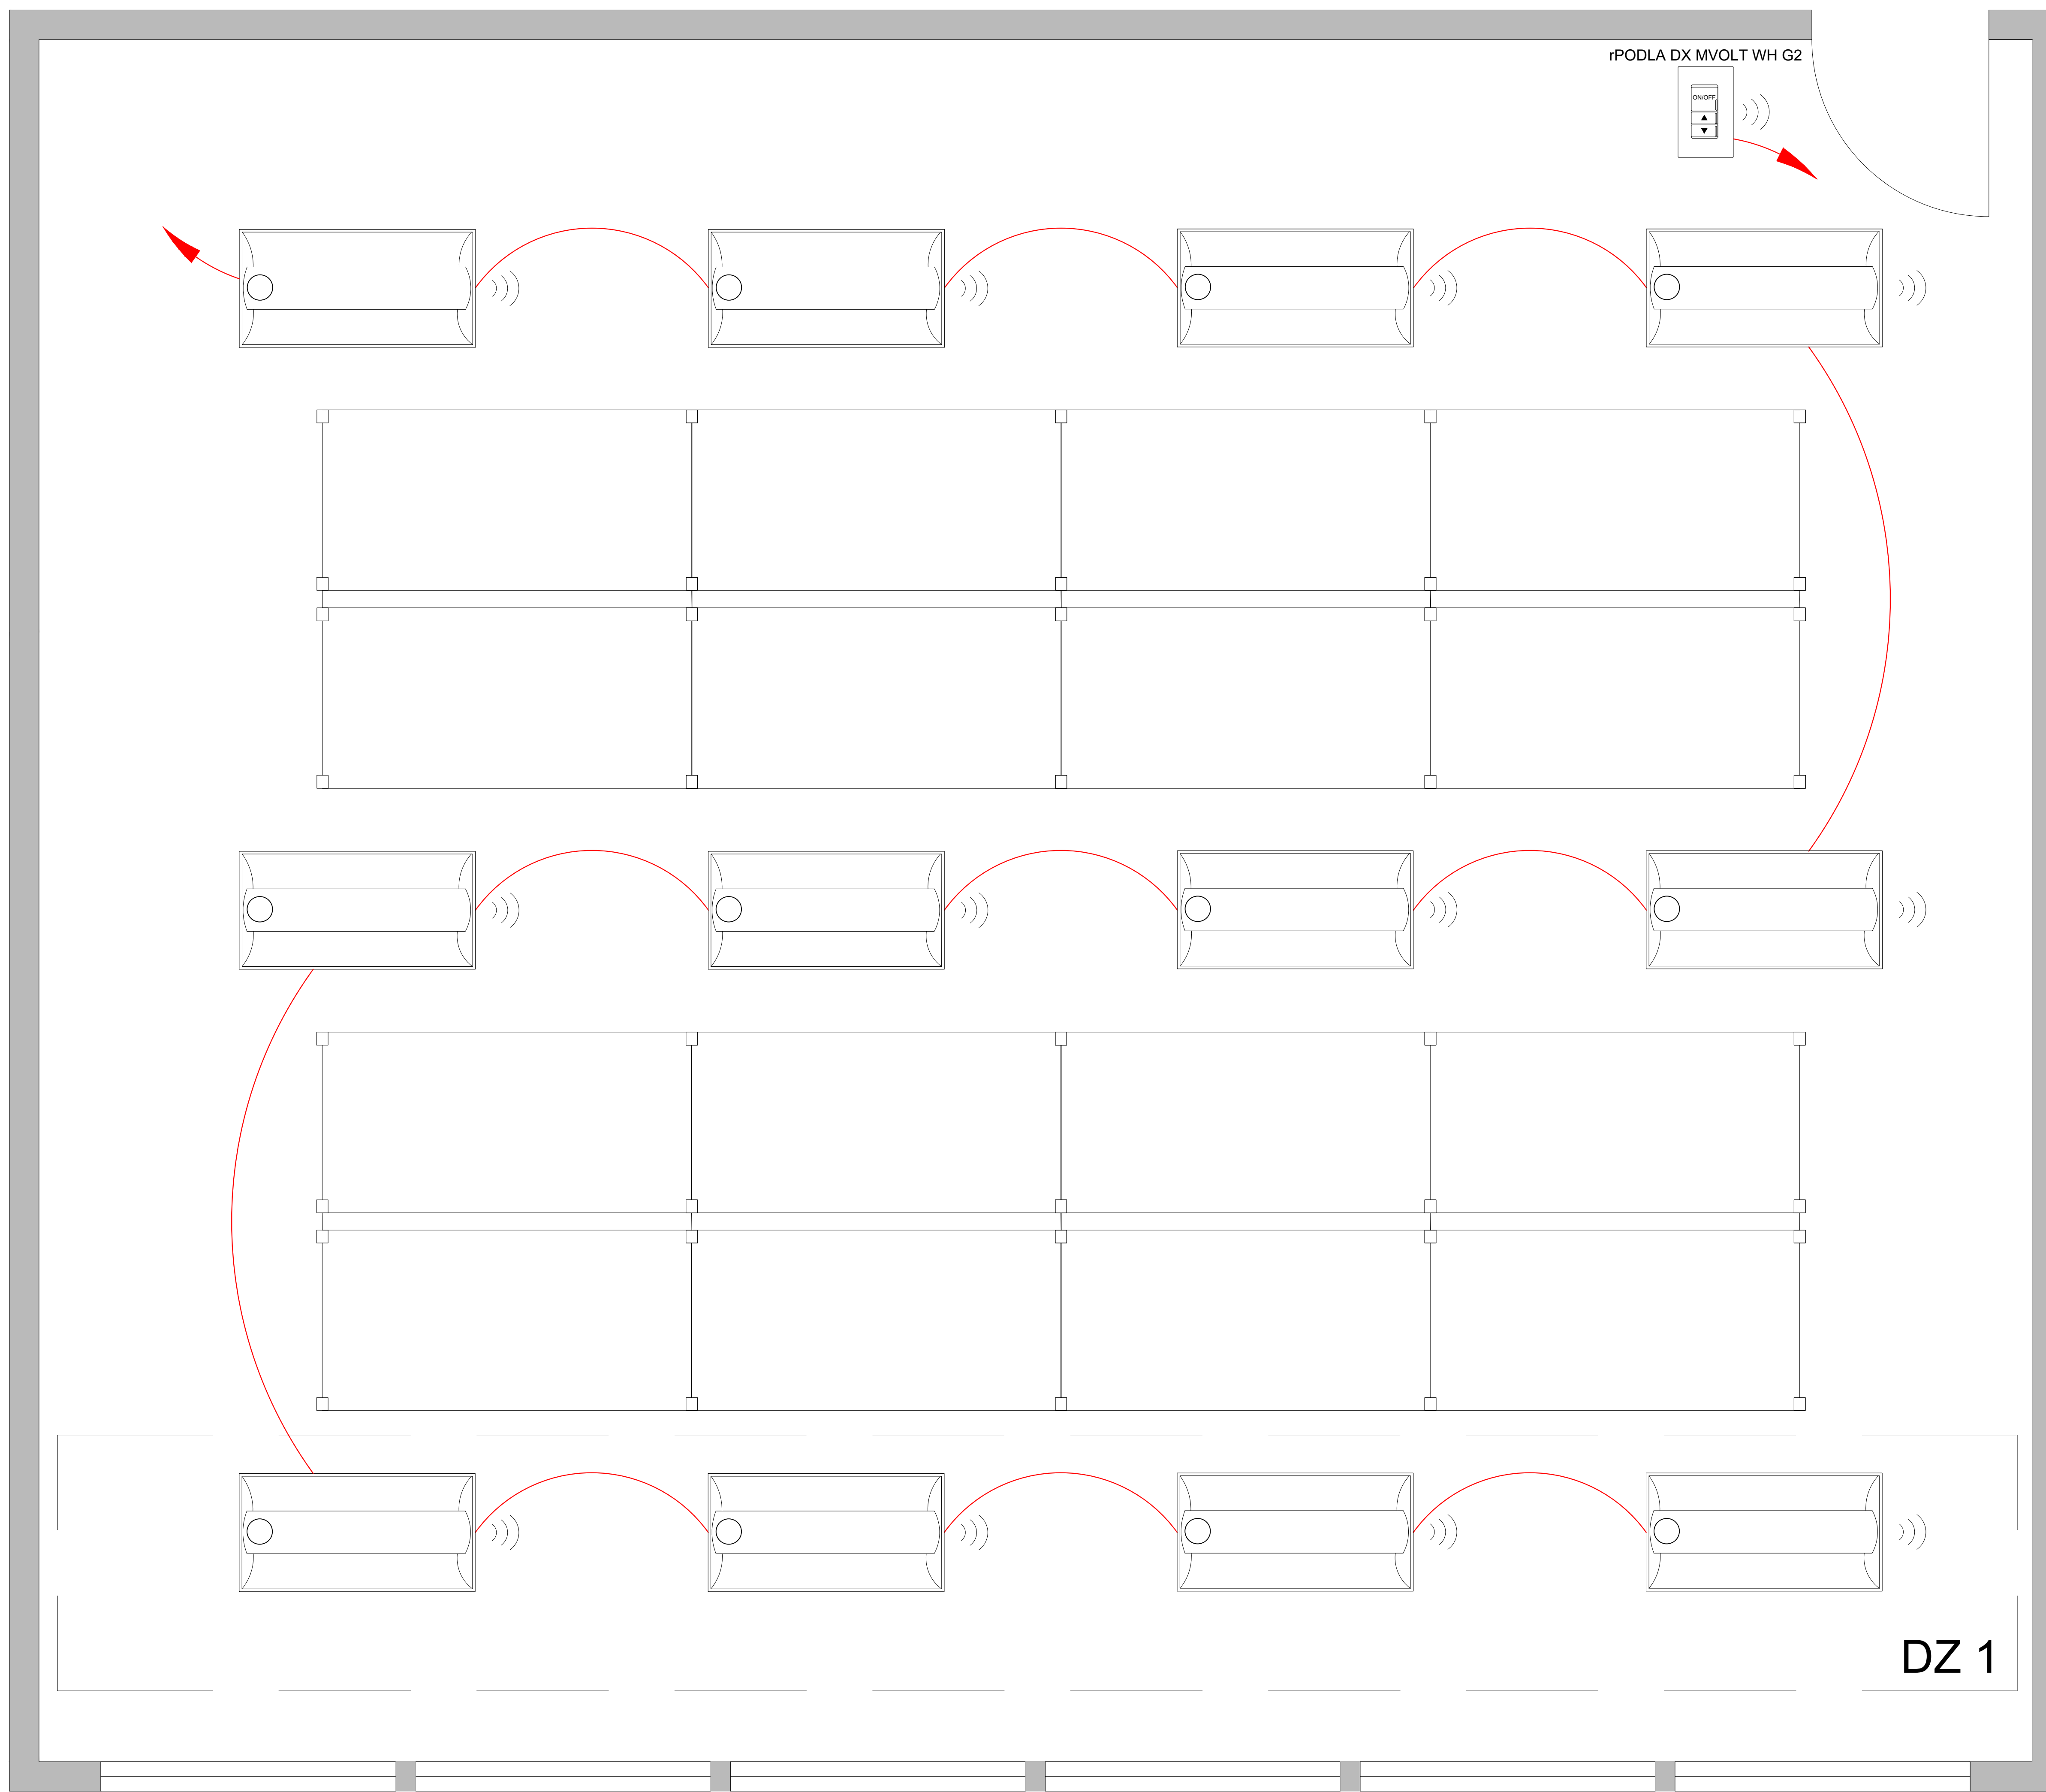


DIAGRAM LEGEND

- LINE VOLTAGE WIRES
- LINE POWER



SUPPORTS THE FOLLOWING REQUIREMENTS:

- OCCUPANT SENSOR CONTROLS, (C405.2.1)
- TIME-SWITCH CONTROLS, (C405.2.2)
- DAYLIGHT-RESPONSIVE CONTROLS, (C405.2.3)
- SPECIFIC APPLICATION CONTROLS, (C405.2.4)
- MANUAL CONTROLS, (C405.2.5)
- ENHANCED DIGITAL LIGHTING CONTROLS, (C406.4)

SEE HILA BASIS OF DESIGN TO COMPLY WITH IECC 2018 SECTION C405